



SERVICE STANDARD
SS-16
 Electric Vehicle
 Charging – Customer
 Owned Equipment

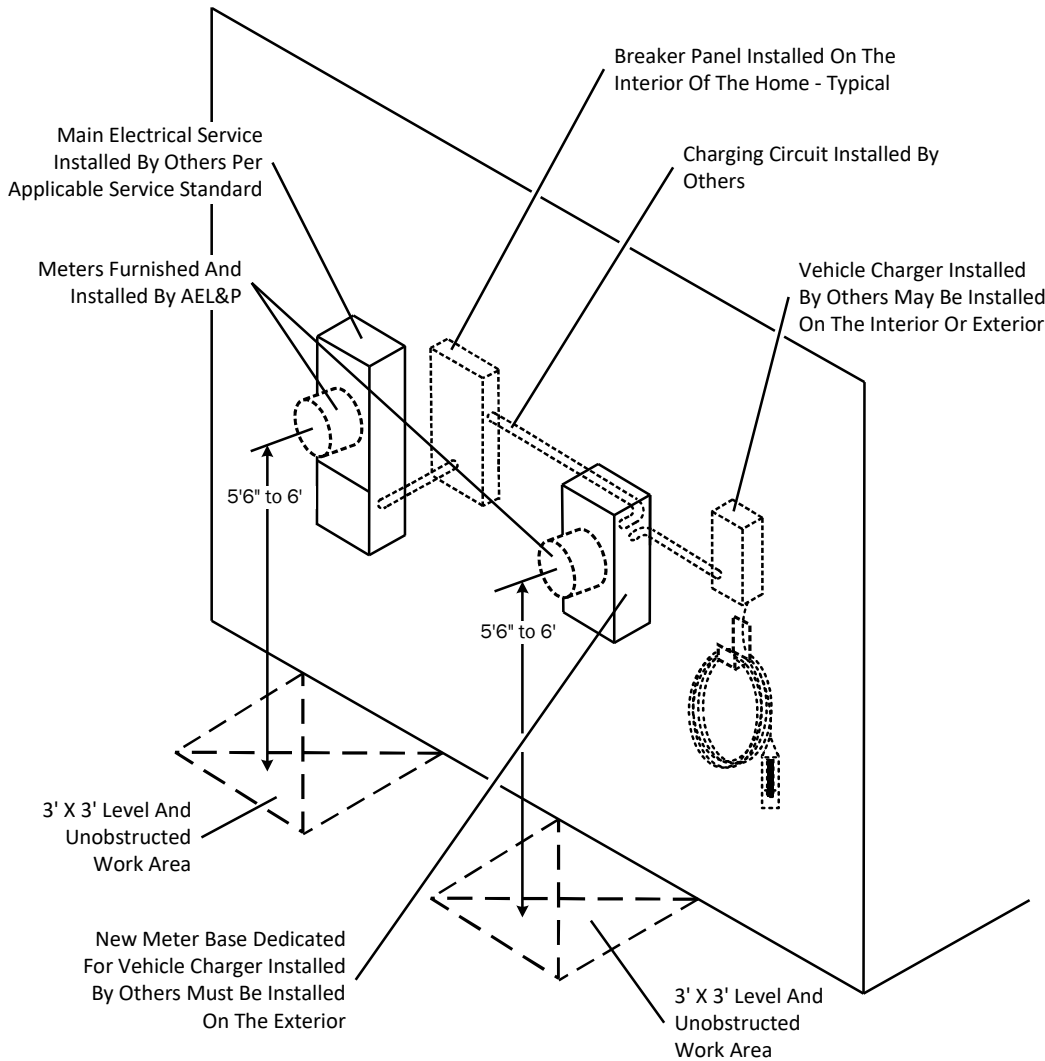

Service Equipment, Circuits, Meter Bases, Chargers And Conduit To Be Installed By Customer.

Typical Wiring Diagram

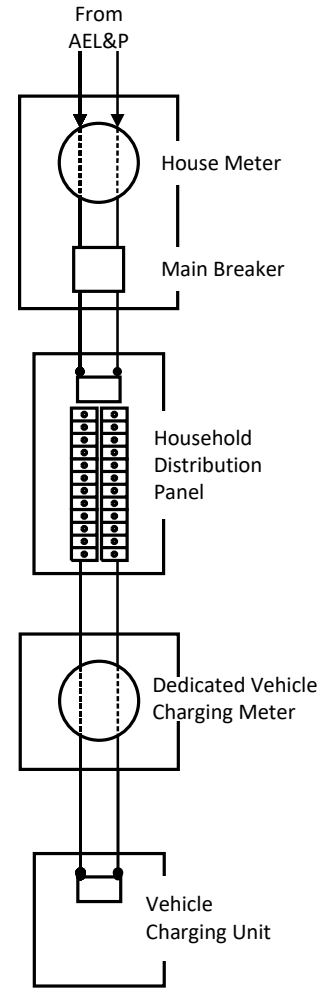

*Single Phase Typical Arrangement Shown

- Service Entrance Location Must Be Approved By AEL&P And Must Be Located As Close As Possible To Existing AEL&P Facilities.
- EV Charging Meter Bases Must Be Installed On The Exterior Of The Structure And "Yellow Tagged" By City Inspectors Prior To The Installation Of Meter.
- Customers Service Equipment Shall Conform To The National Electrical Code And State And Municipal Codes And Shall Be Inspected And Approved Prior To Connection Of Service.