



SERVICE STANDARD
SS-17
Electric Vehicle
Charging – Leased
Equipment

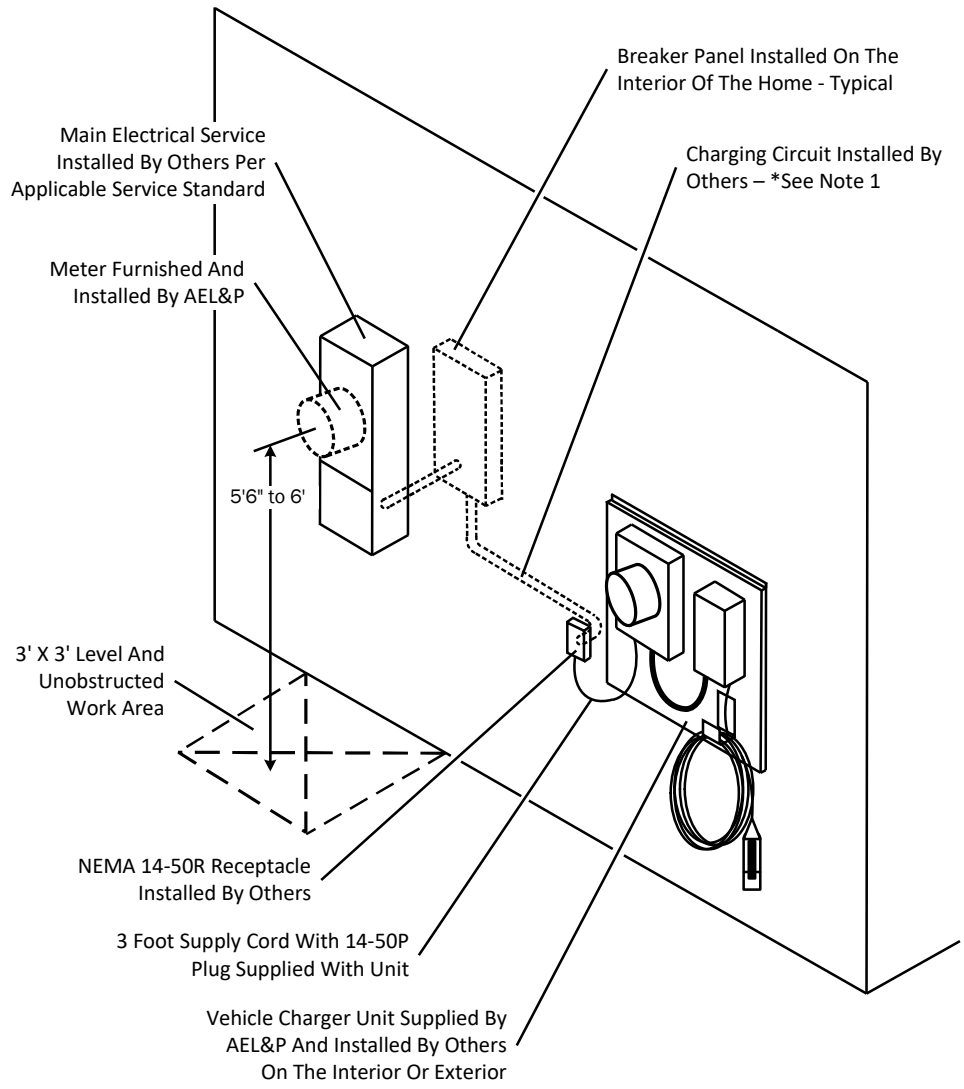

Service Equipment, Circuits, Leased Vehicle Charging Unit And Conduit To Be Installed By Customer.

Typical Wiring Diagram

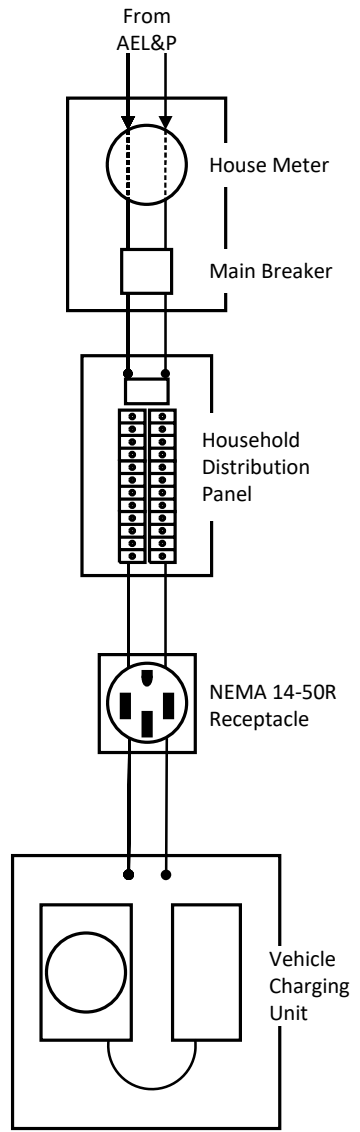

*Single Phase Typical Arrangement Shown

- Customers Service Equipment Shall Conform To The National Electrical Code And State And Municipal Codes And Shall Be Inspected And Approved Prior To Connection Of Service.

*Note 1 – 50 Amp 4 Wire Circuit Typical – Leased Unit Is Adjustable To Accommodate 20, 30, 40 Or 50 Amp Circuit Capacity.